

D001P4500001C

ABILITY CODE FACTORY SETTING(DIAL CODE BY MODEL):

MODEL	SI-1	SI-2	SI-3	SI-4	SI-5	SI-6	SI-7	SI-8
080	0	1	0	1	0	0	0	0
090	0	1	0	1	1	0	1	0
100	0	1	1	0	0	1	0	0
112	0	1	1	1	0	0	0	0
125	0	1	1	1	1	1	0	1
140	1	0	0	0	1	1	0	0
160	1	0	1	0	0	0	0	0

FUNCTION CODE FACTORY SETTING (DEFAULT 0 IF NOT SPECIFIED):

SETTING	0	1
S31-4		1
S31-3	NO HEATER	HAVE HEATER
S31-2	RETURN AIR TEMP.	WIRED CONTROLLER TEMP.
S31-1	CARD IS INVALID	CARD IS EFFECTIVE

MODEL CODE FACTORY SETTING:


SETTING	0	0	0	0
S92-1	S92-2	S92-3	S92-4	

ATTENTION:

- (1) ①② MEAN OPTIONAL MATERIALS;
- (2) - - - - - MEAN ENGINEERING FIELD WIRING;

SYMBOL DISCRPTION:

AP	MAIN BOARD	TH1	COIL INLET TEMP.
PUMP	WATER PUMP	TH2	MIDDLE OF COIL TEMP.
EXV	ELECTRONIC EXPANSION VALVE	TH3	COIL OUTLET TEMP.
FAN	FAN MOTOR	TH4	AMBIENT TEMP.
XT	TERMINAL BLOCKS		

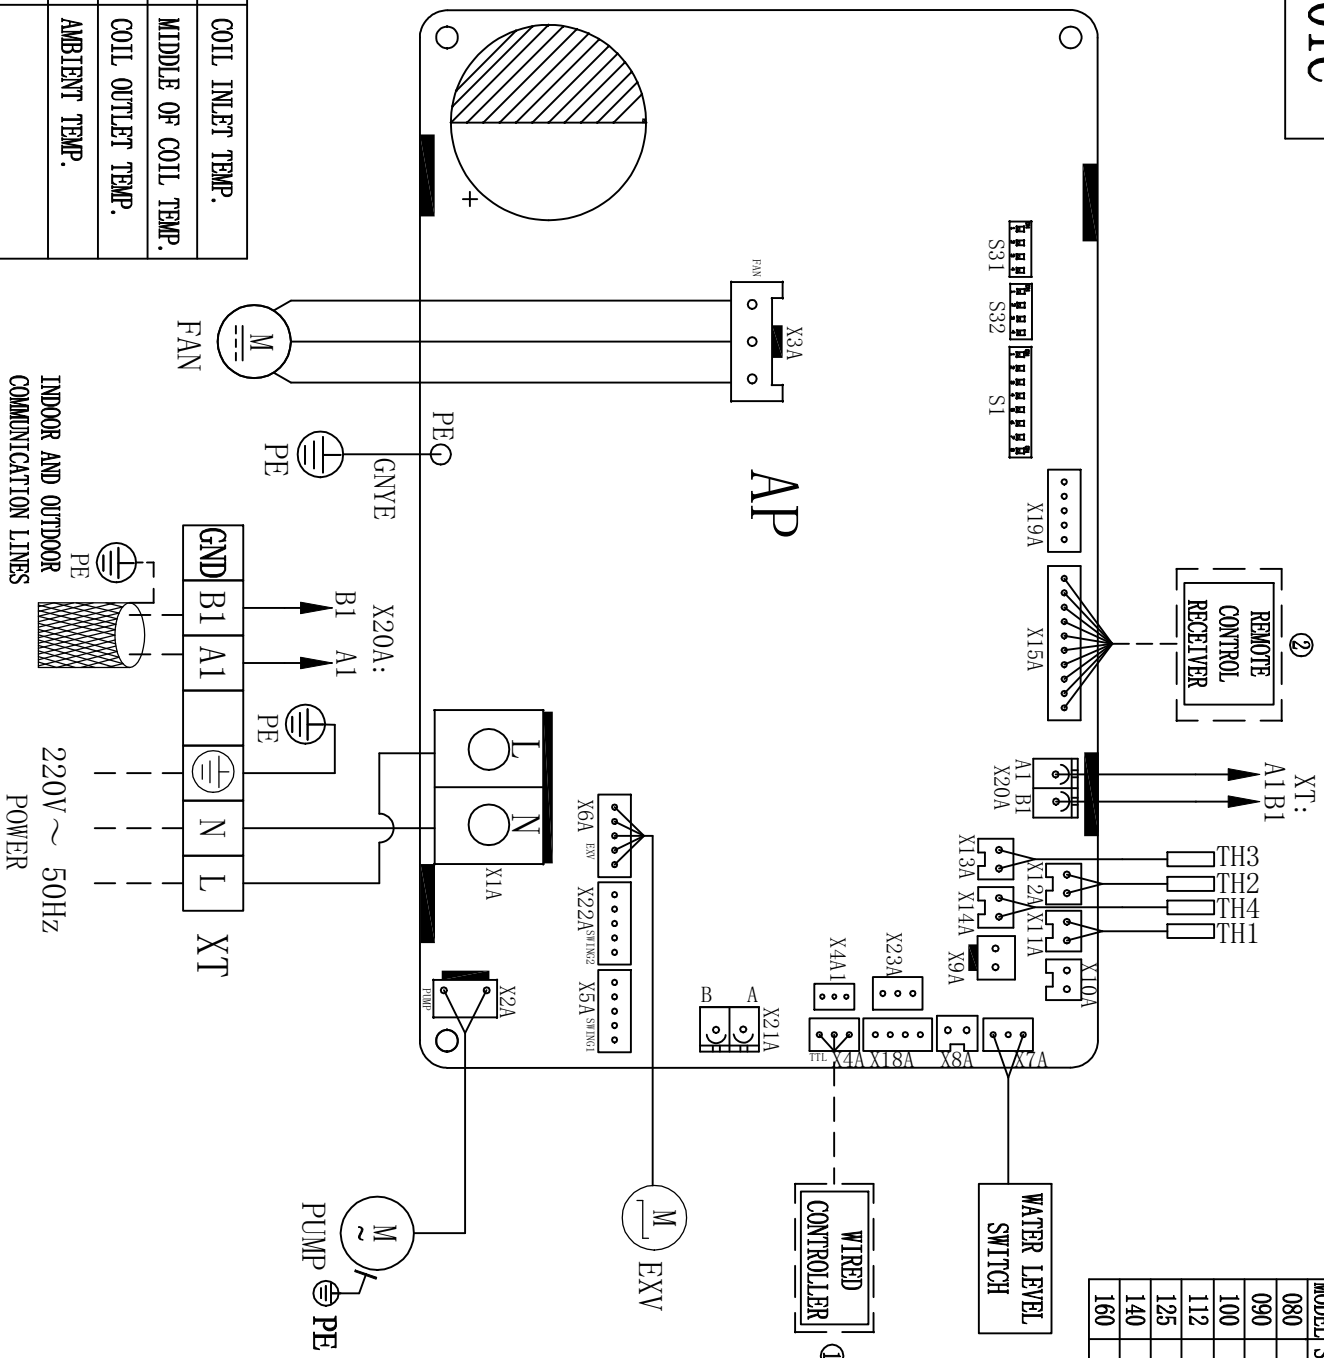

ELECTRICAL LAYOUT

