D0A124500001C

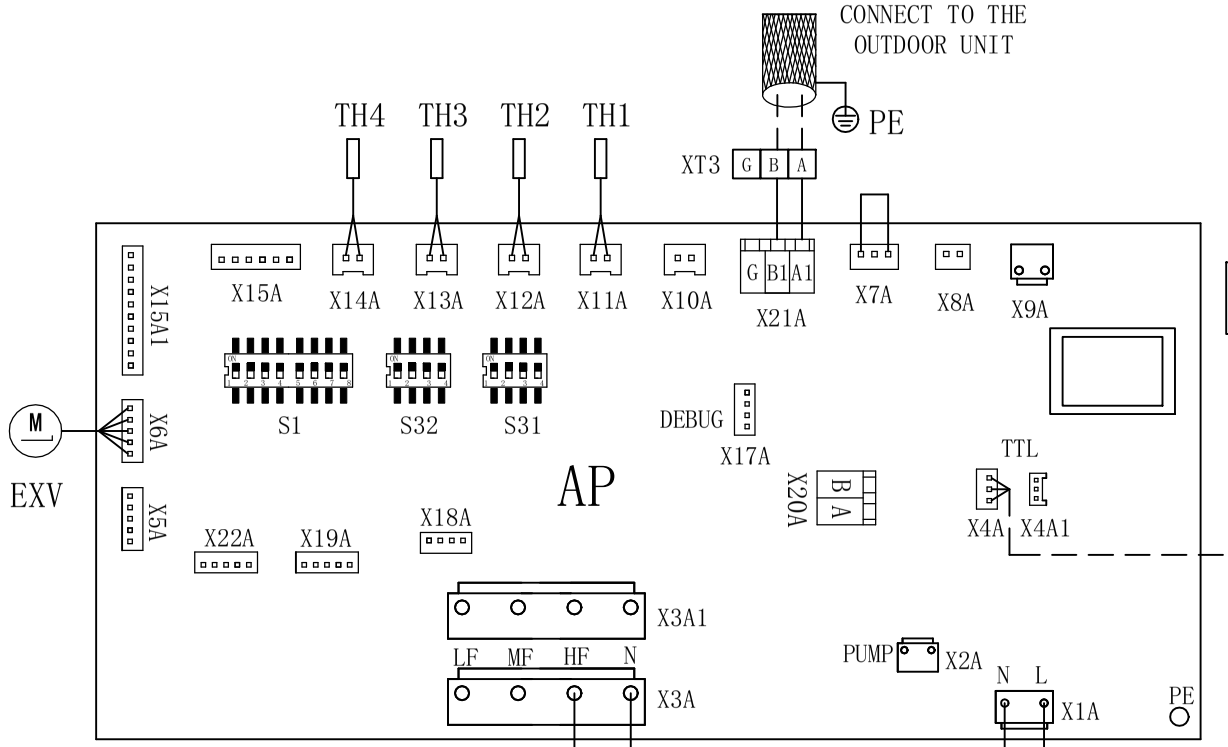

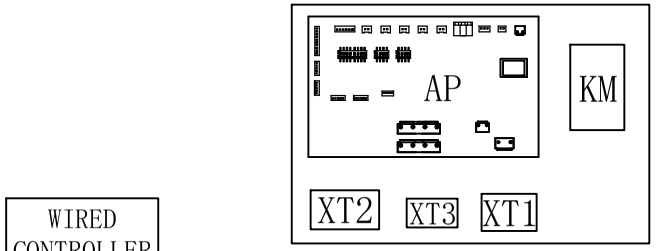

WIRED CONTROLLER

NOTICE:
1、PLEASE USE SHIELDED TWISTED PAIR FOR COMMUNICATION LINE;
2、THE WIRING OF THE FAN IN THIS DRAWING IS FACTORY WIRING. IF THE WIND SPEED NEEDS TO BE ADJUSTED ON SITE, PLEASE REFER TO THE ACTUAL WIND SPEED ADJUSTMENT.

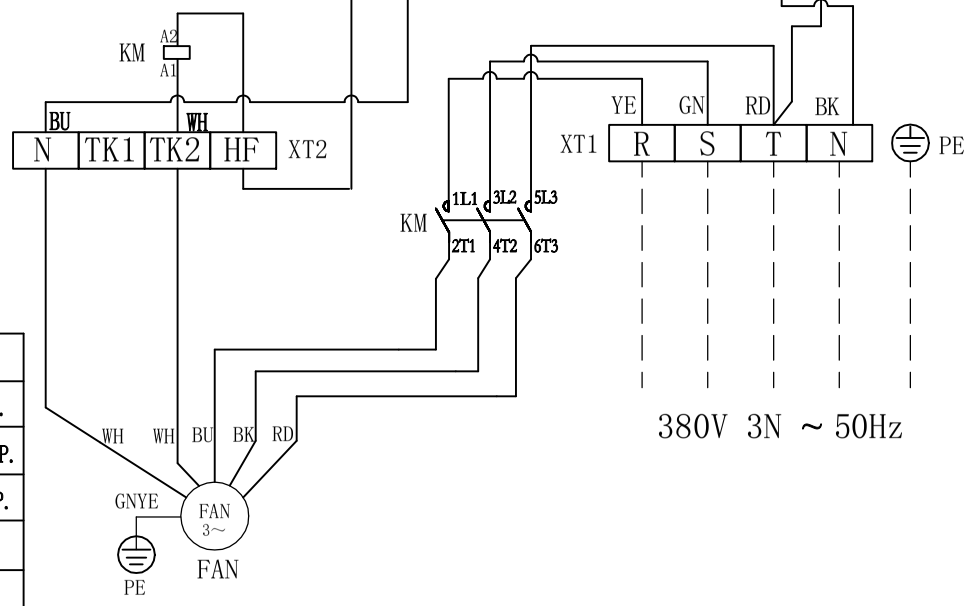

SYMBOL DESCRIPTION:

FAN	FAN MOTOR	XT3	COMMUNICATION TERMINAL BLOCK
EXV	ELECTRONIC EXPANSION VALVE	TH1	COIL INLET TEMP.
AP	MAIN CONTROLLER	TH2	CENTRAL COIL TEMP.
KM	CONTACTOR	TH3	COIL OUTLET TEMP.
XT1	POWER TERMINAL BLOCK	TH4	AMBIENT TEMP.
XT2	FAN TERMINAL BLOCK		

S31:FUNCTION DIP (DEFAULT 0)

DIP	FUNCTION	0	1
S31-1	FUCNTION SELECTION	REMOTE SWITCH	ROOM CARD INTERLOCKING
S31-2	RETURN AIR TEMP. SELECTION	MAIN CONTROLLER TEMP. SENSOR	WIRED CONTROLLER TEMP. SENSOR
S31-3	HEATER	NO HEATER	HEATER
S31-4	FAN MOTOR TYPE	AC	DC

S32:THE TYPE OF THE INDOOR UNIT

S32-1	S32-2	S32-3	S32-4
0	1	1	0

S1:INDOOR UNIT CAPABILITY DIP

MODEL	S1-1	S1-2	S1-3	S1-4	S1-5	S1-6	S1-7	S1-8
175***-022	0	1	0	1	0	0	0	0
210***-020	0	1	1	0	0	1	0	0
250***-015	0	1	1	0	0	1	0	0
250***-020	0	1	1	0	0	1	0	0
250***-030	0	1	1	0	0	1	0	0
300***-020	0	1	1	0	0	1	0	0
400***-020	1	0	1	0	0	0	0	0
400***-030	1	0	1	0	0	0	0	0
500***-020	1	1	0	0	1	0	0	0
500***-030	1	1	0	0	1	0	0	0
600***-020	1	1	0	0	1	0	0	0
600***-030	1	1	0	0	1	0	0	0