



# **Air-cooled Flooded Screw Chiller**TASF Series



### Established in 1991

TICA is a professional enterprise specialized in R&D, manufacturing, sales and services of environment cleaning and thermal energy utilization.

TICA is a national high-tech enterprise, a single leading enterprise cultivated by the Ministry of Industry and Information Technology, a national brand cultivation enterprise of the Ministry of Industry and Information Technology, and a vice chairman member of China Refrigeration and Air-conditioning Industry Association. It has a national-recognized enterprise technology center, an enterprise academician workstation, and a post-doctoral research workstation. Its projects cover Beijing Bird's Nest Stadium, Water Cube, Wukesong Indoor Stadium, PetroChina, Sinopec, State Grid, Nanjing Panda, Hangzhou Xiaoshan International Airport, Hainan Airlines Group, Shangri-La Hotel, Manila Ocean Park, Abu Dhabi Al Muneera, SM City in Philippines and Unilever, etc.

TICA is also the outstanding provider of central air conditioners for China's subway networks and has successfully served nearly 60 key subway lines in major cities such as Beijing, Shanghai, Guangzhou, Shenzhen, Chengdu, Suzhou, Hangzhou and Tianjin. TICA is a professional supplier and service provider in China that specializes in system integration of clean environment. While for microelectronics, hospital operating rooms, biopharmaceutical industry and other professional purification areas, our market share has achieved over 40% in each.

### **TICA Quality For IAQ**

TICA focuses on indoor air quality (IAQ) in clean environments. Product lines include return air purifiers, heat recovery ventilators, fresh air purifiers, air purifiers, as well as the clean air handling units and digital variable-capacity air handling units used in the professional purification field. Regarding core technology, TICA established an ISO class 1 super-clean environment integration system and won the first prize of CMIST.

TICA's product lines include modular chillers, VRF units, screw chillers, centrifugal chillers, and ORC low-temperature waste heat power generation systems. In 2015, TICA and United Technologies Corporation (UTC) established a global strategic joint venture cooperation relationship and acquired PureCycle, an ORC low-temperature power generation company owned by Pratt & Whitney under UTC. TICA obtained PureCycle trademarks and more than 100 patents and national copyrights. TICA's efficient centrifugal chillers, water-cooled screw chillers, and air-cooled screw chillers are manufactured with the technical license of Carrier under UTC.

TICA is characterized by excellent system integration capability. In the application of "Efficient Refrigeration System of Underground Railway Station", the integrated COP of the refrigeration room amounts to 6.0, and the research achievement reaches the international advanced level. In 2018, TICA merged and acquired an OFC central air conditioning enterprise SMARDT.TICA's excellent system integration capability and the SMARDT OFC water chillers help increase the integrated COP of the efficient equipment room to 6.7 to 7.0. TICA---We're striving.

TICA aims to build itself into a world-leading system integration supplier and service provider that specializes in clean environment and thermal energy utilization.











Kuala Lumpur Plant





### Content

D	9	$\alpha$	,

Page
Product Overview 2
Features 3
Specifications 6
Dimensions 16
Installation 18
Routine Maintenance 25




### **Product Overview**

TASF series air-cooled flooded screw chiller is equipped with an R134a special high-efficient twin-screw compressor, a flooded evaporator, a unique oil return technology, an economizer for circulation, and so on. Besides its chilling parts and control components that are all products of international well-known brands. the unit is also provided with a solution for intelligent control. The product, which has the characteristics of high efficiency, energy conservation, stability and reliability, etc., is widely used in many comfortable and technological places such as hotels, hospitals, office buildings, shopping malls, apartments and factories.



#### Nomenclature

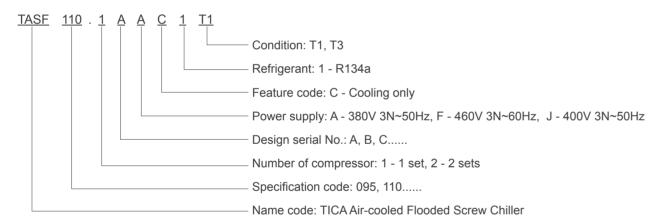

### Operating range

		Operating rang	е	
Model	Water leaving temperature (during operation)	Ambient temperature	Voltage	Water flow
TASF-AAC1T1		5°C-45°C	360V-400V	
TASF-AJC1T1	4°C-20°C	5 C-45 C	380V-420V	FOO/ 1200/ of the naminal water flow
TASF-AAC1T3	4 C-20 C	5°C-52°C	360V-400V	50%-120% of the nominal water flow
TASF-AFC1T1		5°C-45°C	440V-480V	

### Option:

Low Ambient Temperature: The low ambient option adds unit controls and deploy to allow start and operation when the unit works with minimum ambient temperatures at -10°C.

Low Temperature Brine: ethylene glycol and propylene glycol (maximum concentration 45%) can be chosen as optional and leaving water temperature shall not less than -5.6°C.

Anti-corrosion: Blygold coating or electrophoretic coating can be chosen as optional.

Vibration Isolators: Vibration Isolators provide isolation between chiller and structure to help eliminate vibration transmission.

### **Features**

### **Energy-efficient**

### **High-efficiency Compressor**

The high-efficiency semi-hermetic twin-screw compressor, which is specially designed for the R134a refrigerant, can realize stepless regulation for energy through its slide valve. The energy regulation range of a single-compressor unit is from 25% to 100%, and regulation range of a dual-compressor unit is from 12.5% to 100%, which can well avoid the problems faced by ordinary units such as frequent start and stop, large fluctuations in water temperature and especially, excessive temperature and humidity control in technological places, thus minimizing the operation cost.





### High-efficiency Heat Exchanger •-

As for the high-efficiency flooded heat exchanger, the complex tooth-type structure on the external surface of the heat exchange tube facilitates nuclear boiling, thus largely improving the heat transmission outside of the tube: The spiral tooth-type structure on the internal surface helps increase the disturbance of refrigerating medium when it is flowing in the tube, which greatly increases the heat exchange efficiency in the tube.



### Two-stage High-efficiency Oil Separator + Unique Oil Return Technology

The external level-2 oil separator, which is a high-efficiency horizontal oil separator of independent research and development, has a built-in high-strength stainless steel filter screen. Through collision, filtering and gravity, the oil separator can realize an oil separation efficiency of over 99.9%, which greatly reduces oil residual in the heat exchanger and increases the operating efficiency of the entire unit.

The patented continuous oil return technology of TICA - oil injected by oil ensures the safety of oil supply for the compressor as it can take the residual 0.1% refrigeration oil in the evaporator back to the compressor without increasing the power consumption of the compressor.



### Electronic Expansion Valve •


The unit is equipped with an electronic expansion valve that has a high control accuracy and fast response. Under full load and partial load, the electronic expansion valve can always have an excellent performance that helps greatly increase the energy conservation performance and stability of the unit as well as lower the operation cost.





#### Economizer Circulation •

Each unit of the TASF series is designed with an economizer, which dramatically improves the performance and reliability of the unit.






### Comfort and Low Noise

### Precise Control for Water Temperature •

The high-precision stepless regulation to the energy regulation slide valve of the compressor realizes high consistency between the actual load and the target load of the compressor and ensures a perfect match between the output capacity of the unit and the demand load of the building system. "Output on demand" of energy ensures temperature stability of outlet water, and the control precision of water temperature can reach ±0.3°C.

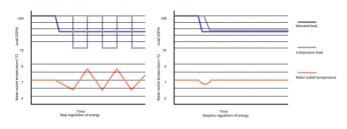

#### Low Noise •

The unit, which adopts a large airflow and low-noise inner rotor axial flow fan of a well-known brand and is equipped with a long air duct for air diversion, can effectively reduce the noise caused by airflow. Before delivery, the fan has undergone strict tests on static and dynamic equilibrium to ensure stable and low-noise operation.

The compressor feet are equipped with rubber shock pads which cannot only reduce unit vibration transmission but also can significantly decrease unit noise;

A noise enclosure and spring shock absorber are also optional for the unit to further reduce noise.





### Environmentally Friendly •

The environmentally-friendly refrigerant HFC-R134a is used, which does not contain chlorine atoms, is harmless to the atmospheric ozone layer, and has no ban period in the Montreal Agreement; Higher efficiency, fewer power consumption and reduced CO2 emissions:

As one of the first enterprises in China's industrial and commercial refrigeration and air-conditioning industry that signed the HCHC Phase-Out Project with the Ministry of Environmental Protection. TICA has always been dedicated to the development of green and environmentally friendly products.



### Reliable Operation

#### Multiple Protection Functions •

The unit provides multiple safety protection functions to conduct all-round comprehensive monitoring for the unit and the system. In case of any abnormality occurring to the application environment or the system, the functions can protect the unit from damage in a timely manner. The unit has three levels of passwords in order to prevent operations by unauthorized personnel and to ensure safe operation of the unit.



Protection of power supply default phase. reverse phase, and unbalanced phase Compressor oil level protection Compressor motor overheat protection Compressor motor overload protection Fan overload protection Compressor start failure protection Compressor reverse rotation protection Protection of too high condensation pressure

Protection of too low evaporation pressure Protection of air suction/discharge pressure difference

Disconnection protection

Protection of too high discharge temperature Protection of too high water temperature Excessive temperature difference protection

### Long-term Simulation Experiment •

TICA has built a large 350RT air cooling unit performance laboratory. The performance, reliability and structure of the unit are verified and optimized by long-term simulation tests under various changing conditions and extreme conditions, as well as transportation experiment on actual tertiary roads in order to ensure the quality and performance of the unit.



### Intelligent Control

#### Intelligent Control System •-

- The industrial-level microcomputer controller and the LCD screen constitute the control center of the unit. In addition, TICA's auto control technology of independent development features the world's most advanced control technology and enables powerful control functions.
- With a cutting-edge intelligent control program and an advanced capacity regulation system, the compressor can realize stepless regulation at a load range of 25% - 100%. The unit load and the load at the user side which are highly matched ensures precise control of water temperature by the unit under all working conditions, and the temperature control precision can reach ±0.3°C.
- The application of graded control for the unit fan effectively reduces the power consumption of the unit in the transitional ambient temperature;
- The advanced pre-control function makes it possible for the operator to take relevant remedy measures in a timely manner before any failure occurs to avoid frequent shutdown of the unit;
- The unit supports the compiling of weekly operating schedules to implement comprehensive automatic start and stop control of the unit, which truly implements unattended and automatic operation.











# **Specifications**

### T1 Condition.(380V 3N~50Hz)

Model	TASF-AAC1T1		095.1	120.1	140.1	155.1	180.1	205.1	225.1	240.1	140.2	160.2	180.2	205.2		
Nie Zaal aug		kW	336	425	495	556	645	725	791	820	503	568	644	732		
Nominal cooli	ng capacity	kcal/h	288960	365500	425700	478160	554700	623500	680260	705200	432580	488480	553840	629520		
Cooling pov	wer input	kW	99.5	133.0	147.0	166.0	190.8	215.8	244.5	255.4	154.8	177.5	200.6	224.6		
EEF	₹	kW/kW	3.38	3.20	3.37	3.35	3.38	3.36	3.24	3.21	3.25	3.20	3.21	3.26		
Cooling rate	d currrent	А	182	229	264	294	340	378	430	447	290	327	362	399		
Maximum star	rtup current	А	358	488	615	683	845	845	965	965	596	601	671	671		
Maximum oper	ating current	А	254	303	353	388	439	480	563	504	435	486	562	562		
Refrigerant	Туре							R1:	34a							
Kenigerani	Refrigerant circuit	igerant circuit number 1									2					
	Туре			Semi-hermetic screw compressor												
Compressor	Energy regulation	n range			25%-1	00% ste	oless regu	ulation			12.5%-	-100% ste	epless reg	Julation		
	Startup Typ	e						Y-	$\triangle$							
	Air flow	m³/h	147000	147000	196000	196000	245000	245000	294000	294000	196000	196000	294000	294000		
Fan	Quantity	Set	6	6	8	8	10	10	12	12	8	8	12	12		
i dii	Fan motor	kW	13.8	13.8	18.4	18.4	23.0	23.0	27.6	27.6	18.4	18.4	27.6	27.6		
	Current	А	31.8	31.8	42.4	42.4	53.0	53.0	63.6	63.6	42.4	42.4	63.6	63.6		
	Туре					Н	lighly Effic	cient Floo	ded Shel	l-and-Tub	е					
	Water flow	m³/h	58	73	85	96	111	125	136	141	87	98	111	126		
Water side heat exchanger	Water pipe diameter	DN(mm)	150	150	150	150	150	150	150	200	150	150	150	150		
3 · · · · · · · · · · · · · · · · · · ·	Water pressure drop	kPa	62	68	71	68	67	71	72	67	62	66	68	71		
	Design Pressure	MPa						1	.0							
	Length	mm	3600	3600	4790	4790	5990	5990	7180	7180	4790	4790	7180	7180		
Dimensions	Width	mm						22	50							
	High	mm						24	60							
Weight of unit	Transportation	kg	3660	4150	4600	4700	5530	5650	6200	6380	5420	5560	7320	7452		
vveignt or unit	Operation	kg	3710	4210	4670	4780	5620	5750	6310	6500	5490	5640	7430	7572		

#### ★Notes

- 1. Nominal cooling condition: chilled water inlet/outlet temperature is 12°C/7°C, ambient dry bulb temperature is 35°C.
- 2. Allowable voltage fluctuation range is 360V~400V.
- 3. The above parameters may change because of product improvement. Therefore, it shall be subject to the parameters on the product nameplate and the actual product.

### T1 Condition.(380V 3N~50Hz)

Model	TASF-AAC1T1		240.2	260.2	280.2	310.2	340.2	360.2	375.2	410.2	445.2	475.2	
Iviodei	IAGI -AACTIT	kW	850	894	989	1112	1184	1291	1316	1450	1564	1682	
Nominal cooli	ng capacity												
0		kcal/h	731000	768840	850540	956320	1018240	1110260	1131760	1247000	1345040	1446520	
Cooling por		kW	266.0	268.8	294.1	335.4	348.8	380.8	391.7	429.4	484.2	523.3	
EEI		kW/kW	3.20	3.33	3.36	3.32	3.39	3.39	3.36	3.38	3.23	3.21	
Cooling rate	d currrent	Α	459	491	527	593	629	679	694	753	851	912	
Maximum sta	rtup current	А	791	968	968	1071	1284	1284	1325	1325	1517	1458	
Maximum oper	ating current	А	606	707	707	777	878	878	960	960	1104	986	
Defrigarent	Туре						R13	34a					
Refrigerant	Refrigerant circuit	number					2	2					
	Туре			Semi-hermetic screw compressor									
Compressor	Energy regulation	n range		12.5%-100% stepless regulation									
	Startup Typ	е					Y-	Δ					
	Air flow	m³/h	294000	392000	392000	392000	490000	490000	490000	490000	450000	450000	
Fan	Quantity	Set	12	16	16	16	20	20	20	20	20	20	
Ган	Fan motor	kW	27.6	36.8	36.8	36.8	46.0	46.0	46.0	46.0	46.0	46	
	Current	А	63.6	84.8	84.8	84.8	106.0	106.0	106.0	106.0	106.0	106.0	
	Туре					Highly E	fficient Floo	ded Shell-a	ınd-Tube				
	Water flow	m³/h	146	154	170	191	204	222	226	249	269	289	
Water side heat exchanger	Water pipe diameter	DN(mm)	200	200	200	200	200	200	200	200	200	200	
Oxonangoi	Water pressure drop	kPa	71	68	71	69	69	68	71	72	72	70	
	Design Pressure	MPa					1.	.0					
	Length	mm	7180	9570	9570	9570	11970	11970	11970	11970	11970	11970	
Dimensions	Width	mm					22	50					
	High	mm	2460					2520					
	Transportation	kg	8300	9080	9200	9400	10910	11060	11120	11300	11850	11950	
Weight of unit	Operation	kg	8430	9220	9350	9560	11080	11240	11310	11500	12060	12170	

#### ★Notes

- 1. Nominal cooling condition: chilled water inlet/outlet temperature is 12°C/7°C, ambient dry bulb temperature is 35°C.
- 2. Allowable voltage fluctuation range is 360V~400V.
- 3. The above parameters may change because of product improvement. Therefore, it shall be subject to the parameters on the product nameplate and the actual product.

TICA





### T1 Condition.(400V 3N~50Hz)

	Model TASF-AJC1T1		095.1	120.1	140.1	155.1	180.1	205.1	225.1	240.1	140.2	160.2	180.2	205.2
		kW	336	425	495	556	645	725	791	820	503	568	644	732
Non	ninal cooling capacity	kcal/h	288960	365500	425700	478160	554700	623500	680260	705200	432580	488480	553840	629520
C	ooling power input	kW	99.5	133.0	147.0	166.0	190.8	215.8	244.5	255.4	154.8	177.5	200.6	224.6
	EER	kW/kW	3.38	3.20	3.37	3.35	3.38	3.36	3.24	3.21	3.25	3.20	3.21	3.26
Co	poling rated currrent	Α	173	218	250	279	323	359	409	425	276	311	344	379
Max	cimum startup current	А	340	464	584	649	803	803	917	917	566	571	637	637
Maxii	mum operating current	Α	241	288	336	369	417	456	534	478	413	462	534	534
Refrigerant	Туре													
Keingerant	Refrigerant circuit numb	er					1					2	2	
	Туре						Semi-he	ermetic s	crew con	pressor				
Compressor	Energy regulation range	е			25%-1	00% ste	pless reg	ulation			12.5%-	100% ste	epless re	gulation
	Startup Type							Y-	Δ					
	Air flow	m³/h	147000	147000	196000	196000	245000	245000	294000	294000	196000	196000	294000	294000
Fan	Quantity	Set	6	6	8	8	10	10	12	12	8	8	12	12
I all	Fan motor	kW	13.8	13.8	18.4	18.4	23.0	23.0	27.6	27.6	18.4	18.4	27.6	27.6
	Current	А	30.2	30.2	40.3	40.3	50.4	50.4	60.5	60.5	40.3	40.3	60.5	60.5
	Туре					H	ghly Effic	cient Floo	ded She	ll-and-Tu	be			
Water	Water flow	m³/h	58	73	85	96	111	125	136	141	87	98	111	126
side heat	Water pipe diameter	DN(mm)	150	150	150	150	150	150	150	200	150	150	150	150
exchanger	Water pressure drop	kPa	62	68	71	68	67	71	72	67	62	66	68	71
	Design Pressure	MPa						1.	.0					
	Length	mm	3600	3600	4790	4790	5990	5990	7180	7180	4790	4790	7180	7180
Dimensions	Width	mm						22	50					
	High	mm						24	60					
Weight of unit	Transportation	kg	3660	4150	4600	4700	5530	5650	6200	6380	5420	5560	7320	7452
vveignt of drift	Operation	kg	3710	4210	4670	4780	5620	5750	6310	6500	5490	5640	7430	7572

#### **→**Notes


- 1. Nominal cooling condition: chilled water inlet/outlet temperature is 12°C/7°C, ambient dry bulb temperature is 35°C.
- 2. Allowable voltage fluctuation range is 380V~420V.
- 3. The above parameters may change because of product improvement. Therefore, it shall be subject to the parameters on the product nameplate and the actual product.

### T1 Condition.(400V 3N~50Hz)

	Model TASF-AJC1T1		240.2	260.2	280.2	310.2	340.2	360.2	375.2	410.2	445.2	475.2
Non	singl applies apposits	kW	850	894	989	1112	1184	1291	1316	1450	1564	1682
INOIT	ninal cooling capacity	kcal/h	731000	768840	850540	956320	1018240	1110260	1131760	1247000	1345040	1446520
С	cooling power input	kW	266.0	268.8	294.1	335.4	348.8	380.8	391.7	429.4	484.2	523.3
	EER	kW/kW	3.20	3.33	3.36	3.32	3.39	3.39	3.36	3.38	3.23	3.21
Co	poling rated currrent	А	436	466	501	563	598	645	659	715	808	866
Max	ximum startup current	А	751	920	920	1018	1220	1220	1259	1259	1441	1385
Maxir	mum operating current	Α	575	671	671	738	834	834	912	912	1049	937
Dofrigoront	Туре						R1	34a				
Refrigerant	Refrigerant circuit numb	er					2	2				
	Туре					Semi-	hermetic s	crew comp	ressor			
Compressor	Energy regulation range	е				12.5%	%-100% ste	epless regu	ulation			
	Startup Type						Υ-	Δ				
	Air flow	m³/h	294000	392000	392000	392000	490000	490000	490000	490000	450000	450000
Fan	Quantity	Set	12	16	16	16	20	20	20	20	20	20
Fall	Fan motor	kW	27.6	36.8	36.8	36.8	46.0	46.0	46.0	46.0	46.0	46.0
	Current	Α	60.5	80.6	80.6	80.6	100.8	100.8	100.8	100.8	100.8	100.8
	Туре					Highly Ef	ficient Floo	ded Shell-	and-Tube			
Water	Water flow	m³/h	146	154	170	191	204	222	226	249	269	289
side heat	Water pipe diameter	DN(mm)	200	200	200	200	200	200	200	200	200	200
exchanger	Water pressure drop	kPa	71	68	71	69	69	68	71	72	72	70
	Design Pressure	MPa					1	.0				
	Length	mm	7180	9570	9570	9570	11970	11970	11970	11970	11970	11970
Dimensions	Width	mm					22	50				
	High	mm	2460					2520				
Weight of unit	Transportation	kg	8300	9080	9200	9400	10910	11060	11120	11300	11850	11950
vveignt of unit	Operation	kg	8430	9220	9350	9560	11080	11240	11310	11500	12060	12170
									•			

#### ★Notes

- 1. Nominal cooling condition: chilled water inlet/outlet temperature is 12°C/7°C, ambient dry bulb temperature is 35°C.
- 2. Allowable voltage fluctuation range is 380V~420V.
- 3. The above parameters may change because of product improvement. Therefore, it shall be subject to the parameters on the product nameplate and the actual product.





### T1 Condition.(460V 3N~60Hz)

	Model TASF-AFC1T1		100.1	120.1	145.1	165.1	190.1	215.1	245.1	265.1	285.1	150.2	165.2	200.2
		kW	355	430	513	579	667	755	867	940	1011	528	589	709
Noi	minal cooling capacity	kcal/h	305300	369800	441180	497940	573620	649300	745620	808400	869460	454080	506540	609740
(	Cooling power input	kW	107.4	133.9	157.6	178.3	203.2	231.5	256.7	292.2	311.5	164.6	183.8	212.6
С	ooling rated currrent	А	157	188	217	253	286	327	358	408	433	242	272	312
	EER	kW/kW	3.31	3.21	3.26	3.25	3.28	3.26	3.38	3.22	3.25	3.21	3.20	3.33
Ma	ximum startup current	А	314	371	465	586	650	805	805	917	917	485	522	533
Maxi	imum operating current	А	219	268	296	335	378	416	466	545	490	370	417	438
	Power supply							460V	~3N~60H	łz				
Defrigerent	Туре							F	R134a					
Refrigerant	Refrigerant circuit number	er					1						2	
	Туре						Semi	-hermetic	screw c	ompress	or			
Compressor	Energy regulation range	Э			25	5%-100%	stepless	regulation	on			12.5%-100	% stepless	regulation
	Startup Type								Y-△					
	Air flow	m³/h	147000	147000	196000	196000	245000	245000	294000	343000	343000	196000	196000	294000
Fan	Quantity	Set	6	6	8	8	10	10	12	14	14	8	8	12
Fall	Fan motor	kW	13.2	13.2	17.6	17.6	22	22	26.4	30.8	30.8	17.6	17.6	26.4
	Current	А	31.8	31.8	42.4	42.4	53	53	63.6	74.2	74.2	42.4	42.4	63.6
	Туре						Highly E	fficient F	looded S	hell-and-	Tube			
Water	Water flow	m³/h	61	74	88	100	115	130	149	162	174	91	101	122
side heat	Water pipe diameter	DN(mm)	150	150	150	150	150	150	200	200	200	150	150	150
exchanger	Water pressure drop	kPa	69	70	76	74	72	77	74	73	71	68	71	68
	Design Pressure	MPa							1.0					
	Length	mm	3600	3600	4790	4790	5990	5990	7180	8380	8380	4790	4790	7180
Dimensions	Width	mm							2250					
	High	mm							2460					
Weight of	Transportation	kg	3630	4120	4570	4670	5520	5610	6140	7020	7050	5240	5340	7260
unit	Operation	kg	3680	4170	4630	4730	5610	5700	6240	7140	7195	5320	5420	7360

#### **★**Notes

- 1. Nominal cooling condition: chilled water inlet/outlet temperature is 12°C/7°C, ambient dry bulb temperature is 35°C.
- 2. Allowable voltage fluctuation range is 440V~480V.
- 3. The above parameters may change because of product improvement. Therefore, it shall be subject to the parameters on the product nameplate and the actual product.

### T1 Condition.(460V 3N~60Hz)

	Model TASF-AFC1T1		225.2	240.2	260.2	290.2	300.2	330.2	345.2	380.2	395.2	430.2	445.2	485.2
Nor	minal cooling capacity	kW	795	860	922	1026	1052	1159	1210	1335	1393	1511	1566	1715
INOII	minal cooling capacity	kcal/h	683700	739600	792920	882360	904720	996740	1040600	1148100	1197980	1299460	1346760	1474900
С	Cooling power input	kW	241.3	267.7	281.8	315.2	328.5	356.6	369.1	402.2	423.3	458.3	469.6	510.8
Co	ooling rated currrent	А	350	376	392	434	474	506	527	566	603	647	660	711
	EER	kW/kW	3.29	3.21	3.27	3.26	3.20	3.25	3.28	3.32	3.29	3.30	3.33	3.36
Max	ximum startup current	А	582	639	761	761	921	921	1028	1028	1221	1221	1260	1260
Maxi	mum operating current	А	482	536	593	593	671	671	756	756	832	832	910	910
	Power supply							460	V~3N~60H	Hz				
D. C.	Туре								R134a					
Refrigerant -	Refrigerant circuit numb	er							2					
	Туре						Sen	ni-herme	tic screw c	ompresso	r			
Compressor	Energy regulation range	е					12.	5%-100%	6 stepless	regulation	l			
	Startup Type								Y-△					
	Air flow	m³/h	294000	294000	392000	392000	392000	392000	490000	490000	490000	490000	450000	450000
Fan	Quantity	Set	12	12	16	16	16	16	20	20	20	20	20	20
ran	Fan motor	kW	26.4	26.4	35.2	35.2	35.2	35.2	44	44	44	44	44	44
	Current	Α	63.6	63.6	84.8	84.8	84.8	84.8	106	106	106	106	106	106
	Туре													
Water	Water flow	m³/h	137	148	159	177	181	199	208	230	240	260	269	295
side heat	Water pipe diameter	DN(mm)	150	200	200	200	200	200	200	200	200	200	200	200
exchanger	Water pressure drop	kPa	71	73	72	68	71	67	72	73	72	72	72	73
	Design Pressure	MPa							1.0					
	Length	mm	7180	7180	9570	9570	9570	9570	11970	11970	11970	11970	11970	11970
Dimensions	Width	mm							2250					
	High	mm	24	60						2520				
	3													
Weight of	Transportation	kg	8170	8240	8980	9140	9260	9340	10850	11040	11080	11280	11630	12040

#### ★Notes

- 1. Nominal cooling condition: chilled water inlet/outlet temperature is 12°C/7°C, ambient dry bulb temperature is 35°C.
- 2. Allowable voltage fluctuation range is 440V~480V.
- 3. The above parameters may change because of product improvement. Therefore, it shall be subject to the parameters on the product nameplate and the actual product.

 $10^{\circ}$  | Tica



### T3 Condition.(380V 3N~50Hz)

Model TASF-AAC1T3	al cooling capacit
Nominal cooling capacity   Real/h   288960   365500   425700   478160   554700   623500   680260   432580   488480	ing power input
kcal/h         288960         365500         425700         478160         554700         623500         680260         432580         488480           Cooling power input         kW         99.5         133.0         147.0         166.0         190.8         215.8         244.5         154.8         177.5           Cooling rated currrent         A         182         229         264         294         340         378         430         290         327           EER         kW/kW         3.38         3.20         3.37         3.35         3.38         3.24         3.25         3.20           Nominal cooling capacity*         kW         298         376         438         493         571         642         701         428         483           Cooling power input*         kW         123.9         165.6         183.1         206.7         237.6         268.7         304.5         189.2         217.0           Cooling rated currrent*         A         222         279         321         357         414         461         524         348         392           Maximum startup current         A         358         488         615         683         845	ing power input
Cooling rated currrent  A 182 229 264 294 340 378 430 290 327  EER	
EER	ig rated currrent
Nominal cooling capacity*   kW   298   376   438   493   571   642   701   428   483	
Nominal cooling capacity*   kcal/h   256280   323360   376680   423980   491060   552120   602860   368080   415380	EER
kcal/h         256280         323360         376680         423980         491060         552120         602860         368080         415380           Cooling power input*         kW         123.9         165.6         183.1         206.7         237.6         268.7         304.5         189.2         217.0           Cooling rated currrent*         A         222         279         321         357         414         461         524         348         392           Maximum startup current         A         358         488         615         683         845         845         965         626         637           Maximum operating current         A         259         379         431         483         526         526         660         496         558           Power supply	
Cooling rated currrent*         A         222         279         321         357         414         461         524         348         392           Maximum startup current         A         358         488         615         683         845         845         965         626         637           Maximum operating current         A         259         379         431         483         526         526         660         496         558           Power supply	cooling capacity
Maximum startup current         A         358         488         615         683         845         845         965         626         637           Maximum operating current         A         259         379         431         483         526         526         660         496         558           Power supply           380V 3N ~ 50Hz	ng power input*
Maximum operating current A 259 379 431 483 526 526 660 496 558  Power supply 380V 3N ~ 50Hz	g rated currrent*
Power supply 380V 3N ~ 50Hz	ım startup currer
	n operating curre
Type R134a	Power supply
	+
Refrigerant Refrigerant circuit number 1 2	
Type Semi-hermetic screw compressor	
Compressor Energy regulation range 25%-100% stepless regulation 12.5%-100% step	or Energy
Startup Type Y-△	S
Air flow m³/h 147000 147000 196000 196000 245000 245000 294000 196000 196000	Air
Quantity         Set         6         6         8         8         10         10         12         8         8	Qua
Fan motor kW 13.8 13.8 18.4 18.4 23.0 23.0 27.6 18.4 18.4	Fan r
	Cur
Current         A         31.8         31.8         42.4         42.4         53.0         53.0         63.6         42.4         42.4	
	Wate
Current         A         31.8         31.8         42.4         42.4         53.0         53.0         63.6         42.4         42.4	eat diam
Current         A         31.8         31.8         42.4         42.4         53.0         53.0         63.6         42.4         42.4           Type         Highly Efficient Flooded Shell-and-Tube	Water r
Current         A         31.8         31.8         42.4         42.4         53.0         53.0         63.6         42.4         42.4           Type         Highly Efficient Flooded Shell-and-Tube           Water flow         m³/h         58         73         85         96         111         125         136         87         98           Water pipe diameter         DN(mm)         150	
Current         A         31.8         31.8         42.4         42.4         53.0         53.0         63.6         42.4         42.4           Water flow         Type         Highly Efficient Flooded Shell-and-Tube           Water flow         m³/h         58         73         85         96         111         125         136         87         98           Water pipe diameter         DN(mm)         150         150         150         150         150         150         150         150         150         150         160         150 <td>dr</td>	dr
Current         A         31.8         31.8         42.4         42.4         53.0         53.0         63.6         42.4         42.4           Water side heat exchanger         Water pipe diameter         DN(mm)         150         150         150         150         150         150         150         150         150         150         150         160	Design F
Current   A   31.8   31.8   42.4   42.4   53.0   53.0   63.6   42.4   42.4	Design F
Current         A         31.8         31.8         42.4         42.4         53.0         53.0         63.6         42.4         42.4           Water side heat exchanger         Water pipe diameter         DN(mm)         158         73         85         96         111         125         136         87         98           Water pipe diameter         DN(mm)         150 </td <td>Design F Ler  S Wie</td>	Design F Ler  S Wie
Current   A   31.8   31.8   42.4   42.4   53.0   53.0   63.6   42.4   42.4	Design F  Ler  S  Wi  Transpi

- 1. Nominal cooling condition: chilled water outlet temperature is 12°C/7°C, ambient dry bulb temperature is 35°C.
- 2.\*:The parameters in condition of:chilled water outlet temperature is 7°C, ambient dry bulb temperature is 46°C.
- 3. Allowable voltage fluctuation range is 360V~400V.
- 4. The above parameters may change because of product improvement. Therefore, it shall be subject to the parameters on the product nameplate and the actual product.

### T3 Condition.(380V 3N~50Hz)


Model T	TASF-AAC1T3		240.2	260.2	280.2	310.2	340.2	360.2	375.2	410.2	445.2
Naviori coli		kW	850	894	989	1112	1184	1291	1316	1450	1564
Nominal coolin	ig capacity	kcal/h	731000	768840	850540	956320	1018240	1110260	1131760	1247000	1345040
Cooling pow	ver input	kW	266.0	268.8	294.1	335.4	348.8	380.8	391.7	429.4	484.2
Cooling rated	d currrent	А	459	491	527	593	629	679	694	753	851
EER	}	kW/kW	3.20	3.33	3.36	3.32	3.39	3.39	3.36	3.38	3.23
Nominal coolin	og conocitu'*	kW	753	760	876	985	1007	1144	1119	1284	1385
Nominal Coolin	g capacity	kcal/h	647580	653600	753360	847100	866020	983840	962340	1104240	1191100
Cooling pow	er input*	kW	331.3	328.6	366.2	417.7	426.3	474.2	478.8	534.7	603.0
Cooling rated	d currrent*	А	559	587	642	722	753	826	830	917	1036
Maximum star	tup current	А	867	1046	1046	1166	1371	1371	1371	1371	1614
Maximum opera	ating current	А	758	863	863	967	1052	1052	1052	1052	1298
Pov	wer supply					38	80V 3N ~ 50H	Hz			
Refrigerant -	Туре						R134a				
rteingerant	Refrigerant circuit	number					2				
	Туре					Semi-herm	netic screw c	ompressor			
Compressor	Energy regulation	n range				12.5%-10	0% stepless	regulation			
	Startup Typ	е					Y-△				
	Air flow	m³/h	294000	392000	392000	392000	490000	490000	490000	490000	450000
Fan -	Quantity	Set	12	16	16	16	20	20	20	20	20
i dii	Fan motor	kW	27.6	36.8	36.8	36.8	46.0	46.0	46.0	46.0	46.0
	Current	А	63.6	84.8	84.8	84.8	106.0	106.0	106.0	106.0	106.0
	Туре										
	Water flow	m³/h	146	154	170	191	204	222	226	249	269
Water side heat exchanger	Water pipe diameter	DN(mm)	200	200	200	200	200	200	200	200	200
	Water pressure drop	kPa	71	68	71	69	69	68	71	72	72
	Design Pressure	MPa					1.0				
	Length	mm	7180	9570	9570	9570	11970	11970	11970	11970	11970
Dimensions	Width	mm					2250				
	High	mm	2460				25	20			
Moight of unit	Transportation	kg	8300	9080	9200	9400	10910	11060	11120	11300	11850
Weight of unit											

- 1. Nominal cooling condition: chilled water inlet/outlet temperature is 12°C/7°C, ambient dry bulb temperature is 35°C.
- 2.\*:The parameters in condition of:chilled water outlet temperature is 7°C, ambient dry bulb temperature is 46°C.
- 3. Allowable voltage fluctuation range is 360V~400V.
- 4. The above parameters may change because of product improvement. Therefore, it shall be subject to the parameters on the product nameplate and the actual product.




# Water Pressure Drop Curve


### Water Pressure Drop Curve-Single Compressor(50Hz)

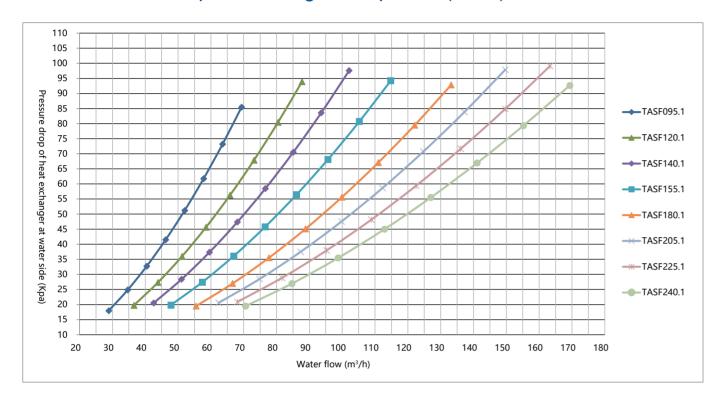


### Water Pressure Drop Curve-Dual Compressors(50Hz)

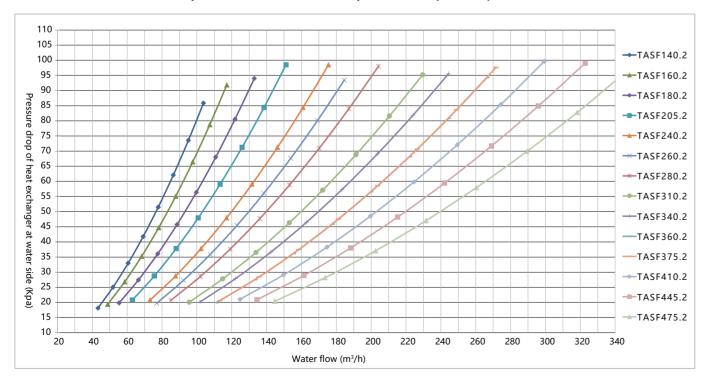

### Water Pressure Drop Curve-Single Compressor(60Hz)

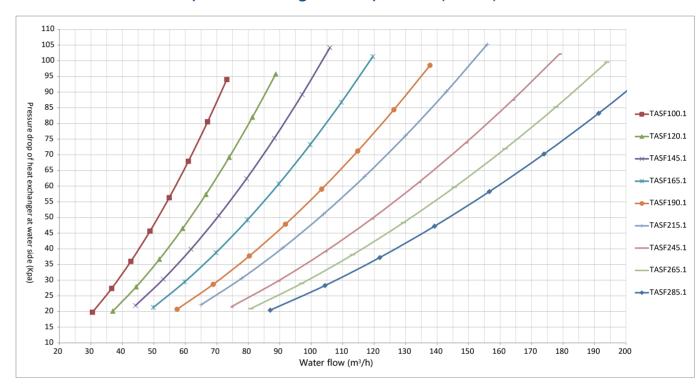


### Water Pressure Drop Curve-Dual Compressors(60Hz)

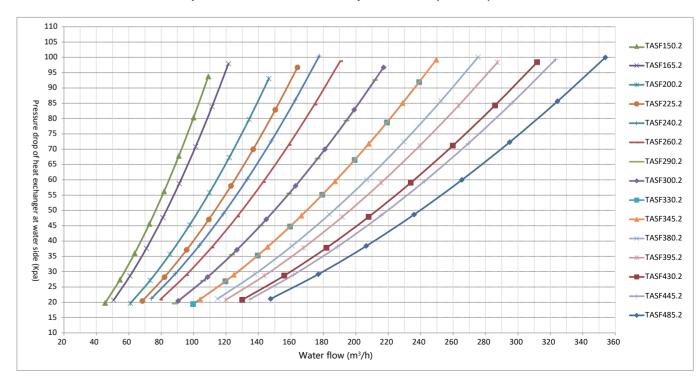





# **TASF Dimensions Data**


### 095.1/100.1/120.1







140.1/145.1/155.1/165.1 140.2/150.2/160.2/165.2







180.1/190.1/205.1/215.1






225.1/240.1/245.1 180.2/200.2/205.2/225.2/240.2

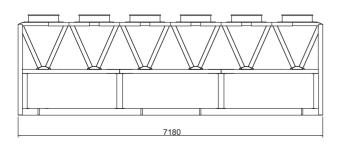





### 265.1/285.1

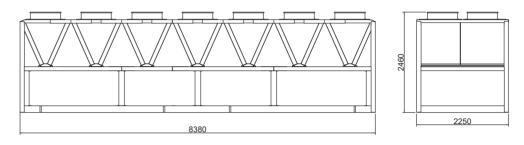


### 260.2/280.2/290.2/300.2/310.2/330.2

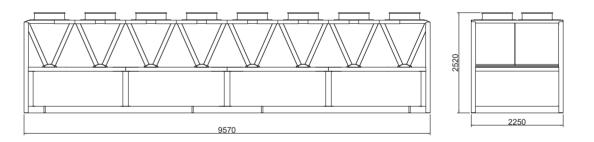

### 340.2/345.2/360.2/375.2/380.2/395.2/410.2/430.2/445.2/475.2/485.2

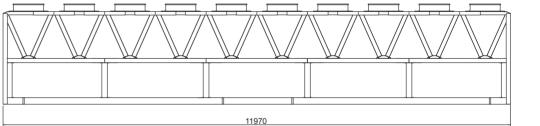






# **Unit Installation Diagrams**

### Diagram for Installation Space of Unit


Layout requirements for corners or depressions

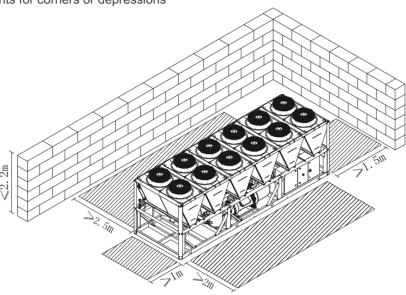

#### ★ Notes

- 1. The unit must be installed in a place with good ventilation and heat transmission. To prevent inverse flow of condenser air, it is recommended to reserve side spacing as shown above; under such conditions, there should not be any obstacles above the unit.
- 2. In case of any structure above the unit, a space height of at least 3 meters shall be reserved between the structure and the unit so as to ensure free airflow for the unit;
- 3. Since the re-circulating hot air seriously affects the energy efficiency ratio of the unit or even causes the condensing pressure to be too high or the fan motor to fail, please make sure to meet the requirement for installation space mentioned above.


### Diagram for Lifting and Placement of Unit

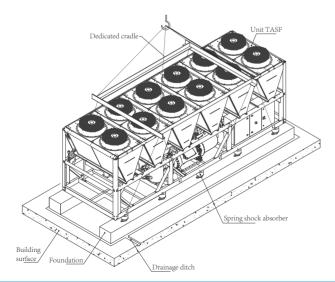

#### ★ Notes

- 1. Lift the unit according to the diagram. Make sure to use special lifting equipment such as cradle to protect the unit;
- 2. In case of any scratches occurring during the lifting process, it is recommended to treat the damaged parts.

# **Foundation Diagrams**

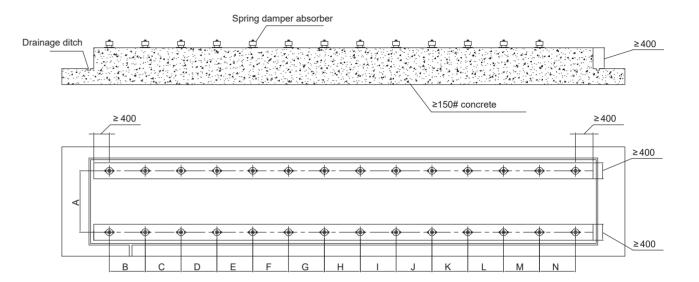

Model							Code	(mm)							Spring damp	per absorber
Model	А	В	С	D	Е	F	G	Н	I	J	K	L	М	N	Model	Quantity
TASF095.1AA/JC1T1 TASF095.1AAC1T3 TASF100.1AFC1T1	2170	1392	1392	-	-	-	-	-	-	-	-	-	-	-	MHD-850	6
TASF120.1AA/JC1T1 TASF120.1AAC1T3 TASF120.1AFC1T1	2170	1392	1392	-	-	-	-	-	-	-	-	-	-	-	MHD-1050	6
TASF140.1AA/JC1T1 TASF140.1AAC1T3 TASF145.1AFC1T1	2170	1390	1390	1390	-	-	-	-	-	-	-	-	-	-	MHD-810	8
TASF155.1AA/JC1T1 TASF155.1AAC1T3 TASF165.1AFC1T1	2170	1390	1390	1390	-	-	-	-	-	-	-	-	-	-	MHD-850	8
TASF180.1AA/JC1T1 TASF205.1AA/JC1T1 TASF180.1AAC1T3 TASF205.1AAC1T3 TASF190.1AFC1T1 TASF215.1AFC1T1	2170	1340	1340	1340	1340	-	-	-	-	-	-	-	-	-	MHD-810	10

#### ★ Notes

- 1. Foundation levelness ≤ 0.1%;
- 2. The bearing capacity of foundation ≥ 1.5 times of the operating weight of unit;
- 3. Drainage ditches must be provided around the foundation to prevent accumulation of water;
- 4. Shock absorbers must be installed between the unit and the foundation (the shock absorber itself has anti-slip and anti-roll functions and does not need to be fixed on the foundation).



Madal	Code (mm)											Spring damper absorber				
Model	А	В	С	D	Е	F	G	Н	I	J	K	L	M	N	Model	Quantity
TASF225.1AA/JC1T1 TASF240.1AA/JC1T1 TASF225.1AAC1T3 TASF245.1AFC1T1	2170	1588	1588	1588	1588	-	-	-	-	-	-	-	-	-	MHD-920	10
TASF265.1AFC1T1 TASF285.1AFC1T1	2170	1300	1300	1300	1300	1300	1300	-	-	-	-	-	-	-	MHD-730	14
TASF140.2AA/JC1T1 TASF160.2AA/JC1T1 TASF140.2AAC1T3 TASF160.2AAC1T3 TASF150.2AFC1T1 TASF165.2AFC1T1	2184	1390	1390	1390	-	-	-	-	-	-	-	-	-	-	MHD-1050	8
TASF180.2AA/JC1T1 TASF205.2AA/JC1T1 TASF180.2AAC1T3 TASF205.2AAC1T3 TASF 200.2AFC1T1	2184	1588	1588	1588	1588	-	-	-	-	-	-	-	-	-	MHD-1050	10
TASF240.2AA/JC1T1 TASF240.2AAC1T3 TASF 225.2AFC1T1 TASF240.2AFC1T1	2184	1588	1588	1588	1588	-	-	-	-	-	-	-	-	-	MHD-1200	10
TASF260.2AA/JC1T1 TASF280.2AA/JC1T1 TASF260.2AAC1T3 TASF280.2AAC1T3 TASF260.2AFC1T1 TASF290.2AFC1T1	2184	1255	1255	1255	1255	1255	1255	1255	-	-	-	-	-	-	MHD-810	16
TASF310.2AA/JC1T1 TASF310.2AAC1T3 TASF300.2AFC1T1 TASF330.2AFC1T1	2184	1255	1255	1255	1255	1255	1255	1255	-	-	-	-	-	-	MHD-850	16
TASF340.2AA/JC1T1 TASF360.2AA/JC1T1 TASF375.2AA/JC1T1 TASF410.2AA/JC1T1 TASF340.2AAC1T3 TASF360.2AAC1T3 TASF375.2AAC1T3 TASF410.2AAC1T3 TASF410.2AAC1T3 TASF345.2AFC1T1 TASF380.2AFC1T1 TASF395.2AFC1T1 TASF430.2AFC1T1	2184	1240	1240	1240	1240	1240	1240	1240	1240	1240	-	-	-	-	MHD-810	20
TASF445.2AA/JC1T1 TASF475.2AA/JC1T1 TASF445.2AAC1T3 TASF445.2AFC1T1 TASF485.2AFC1T1	2184	1240	1240	1240	1240	1240	1240	1240	1240	1240	-	-	-	-	MHD-850	20


#### ★ Notes

- 1. Foundation levelness ≤ 0.1%;
- 2. The bearing capacity of foundation ≥ 1.5 times of the operating weight of unit;
- 3. Drainage ditches must be provided around the foundation to prevent accumulation of water;
- 4. Shock absorbers must be installed between the unit and the foundation (the shock absorber itself has anti-slip and anti-roll functions and does not need to be fixed on the foundation).

# On-Site Wiring Diagram

### Single compressor



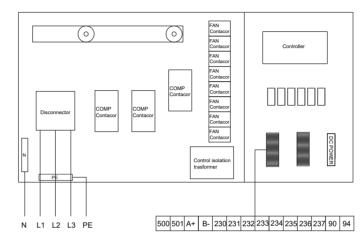

90 , 94 : Remote start & stop;

A+ , B- : Remote communication.

#### Output :

230 , 231 : Run ;

232 , 233 : Alarm ;


234, 235: Pump;


236 , 237 : Reserved

500 , 501 : Multi communication

### **Dual compressors**

#### 1#SYSTERM

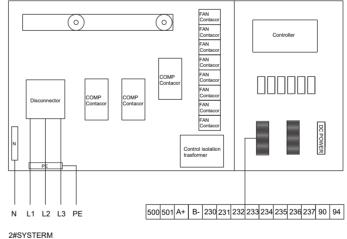

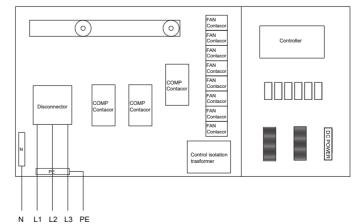

90 , 94 : Remote start & stop;

A+ . B- : Remote communication.

#### Output :

230 , 231 : Run ;

232 , 233 : Alarm ;

234 , 235 : Pump ;

236 , 237 : Reserved ;

500 , 501 : Multi communication

20 TICA



# Installation and Debugging

The unit installation and maintenance must be carried out by professionals who have received professional training, get familiar with the local standards and rules, and have practical operation experience and qualifications of refrigeration equipment. The first operation of the unit must be carried out by the professional service department; otherwise, the quality of the unit is hardly guaranteed.

#### Handling of Uni

The entire unit is transported, and the refrigerant required for normal operation has been charged in the unit. Handle the unit carefully, avoiding damages to it due to reckless operation or refrigerant leakage.

#### Acceptance Upon Delivery at Site

After arrival of the equipment, carefully check whether all the items are complete against the packing list, and whether the parts are damaged during transportation; if any parts are damaged, notify the forwarder and put forward a written compensation request. Our company will not bear the liability for compensation for any damages that arise after the acceptance of the goods.

#### Lifting of Uni

Be sure to use a cable twisted rope or chain with a sufficient bearing capacity to fasten the steel pole passing through the lifting hole on the unit base to lift the unit, and operate according to the requirements of the lifting diagram; make sure that the panel of the fins and other parts of the unit are not damaged, and note to use special lifting equipment such as spreader bar and cradle to protect the unit during lifting; do not tilt the unit by more than 30°.

#### Foundation Requirements

The unit should be placed on a horizontal plane foundation, bottom floor or building roof that can bear the operating weight of the entire equipment. Please refer to the unit nameplate for the operating weight. Spring damper absorbers must be provided if the unit is to be installed on a building roof so as to avoid vibration and noise transmission. If the unit location is too high which makes it inconvenient for the maintenance personnel to conduct maintenance, it should set up appropriate scaffolds around the unit and the scaffolds must bear the weight of maintenance personnel and equipment. (You may refer to some of the requirements on the Foundation Drawing of Unit above).

#### **Environmental Requirements**

It is better to install the unit in a relatively spacious area where sufficient air can flow by the fin coil. There should be enough spacing around the unit to allow air to flow into the fin coil and such space can also be used as maintenance passages. (You may refer to some of the requirements on the Diagram for Installation Space of Unit above). It is proper to use the unit in a region with an ambient temperature above -15°C. In areas with snowfalls in winter where the unit also needs to operate in winter, the installation height must be increased and it is recommended to install a snow cover for the unit if there may be snow accumulation at the installation site so as to ensure normal air flow by the fin coil.

#### Water Pipe Installation


Check valves must be installed at the unit inlet and outlet to facilitate routine maintenance of the water system. It is suggested to install a thermometer and a pressure meter at the water inlet/outlet of the heat exchanger of the unit in order for ease of regular inspection and repair; A water filter should be installed at the water inlet of the pump to avoid impurities entering the pump and the heat exchanger; It should check the water tightness of the pipeline before the pipe is wrapped with thermal insulation materials and before the water enters the unit; All pipelines connecting to the unit should be installed with a vibration damping device; A flow control device meeting the requirements must be installed; The blow-off pipe installed for the air conditioning engineering system must keep away from the inlet and outlet water pipelines of the heat exchanger of the unit, otherwise it will the normal operation of the unit


#### Water Quality Requirements

The compositions of water in various regions are relatively complicated. If water different from the common water quality is used, the water should be tested before entering the heat exchanger of the unit. If the water quality does not meet the requirements of air conditioning water, water treatment is required. For water treatment, see the Code for Design of Industrial Recirculating Cooling Water Treatment or other relevant standards. See the following table for reference indexes

Item	Unit	Allowable values required by air conditioning water
Suspended substance	mg/L	< 10
pH value (25°C)	mg/L	6.5 - 8.0
Conductivity (25°C)	μS/L	< 800
Methyl orange alkalinity	mg/L	< 150
Acid consumption (PH = 4.8)	mg/L	< 100
Total hardness CaCO <sub>3</sub>	mg/L	< 200
Fe <sup>2+</sup>	mg/L	< 1.0
CI-	mg/L	< 200
SO <sub>4</sub> <sup>2</sup> -	mg/L	< 200
SiO <sub>2</sub>	mg/L	< 50
NH <sub>4</sub> <sup>+</sup>	mg/L	< 1.0
S <sup>2</sup> -	mg/L	Cannot be detected
Free chlorine	mg/L	< 1.0
Petroleum category	mg/L	< 5

# Water Pipe Connection Diagram

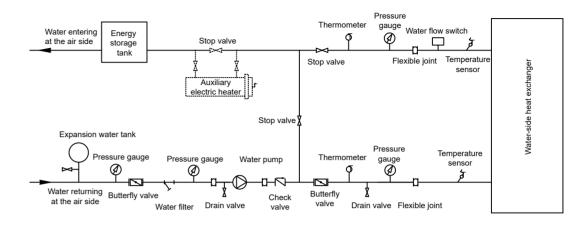

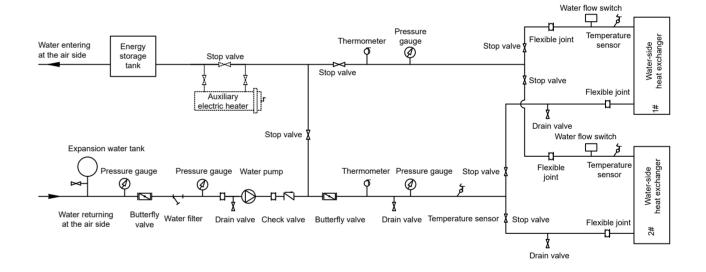

#### ★ Notes

- 1. Water cycling system shall be designed as simple as possible and avoid the use of too many elbows. Straight pipes shall be arranged on the same plane where possible.
- 2. Pay attention to the locations of water inlet and outlet of the heat exchanger to prevent connection errors.
- 3. Install manual or automatic air release valve at the top points of water cycling system
- 4. Expansion tank shall be anti-corrosive and rust proof and installed at the top points of entire pipeline system.
- 5. Install a thermometer and pressure meter at the water inlet and outlet.
- 6. For the dual-compressor unit, a temperature sensing blind pipe shall be reserved at the user's general water pipe in order to further install a temperature sensor.
- 7. Water drain valves should be installed at the bottom of elbows to make sure the water in the whole unit is emptied.
- 8. Install a stop valve at the pipeline connecting the heat exchanger of the unit to the user's water pipe.
- 9. Install a bypass valve between the water inlet pipe and the water outlet pipe of the heat exchanger of the unit in order for ease of maintenance and pipeline washing.
- 10. Install flexible joints to reduce vibration of pipelines.
- 11. Impurities in the water system will cause fouling and scaling on the heat exchanger, so a filter should be installed upstream the pump.
- 12. To boost cooling performance and save energy, pipelines shall be completely insulated.
- 13. To prevent frequent breakdowns of the unit caused by too small load, it is recommended to use energy storage tank.

ZZ TICA



# Selection of Water System Parts

Stop Valve	Determine the valve according to the water pipe diameter. Usually the pipe diameter of the selected valve is identical to that of the connecting pipe of the unit.
Water Filter	It is used to filter the impurities from the water system. Usually select a filter with more than 60 meshes.
Check Valve	It is installed at the water pump outlet to prevent damage to the water pump when water flows back. The diameter of the valve pipe is identical to that of the connecting pipe of the unit.
Bypass Valve	It is installed between the inlet water pipe and outlet water pipe of the unit vessel. Open this valve when cleaning the pipeline.
Thermometer	It is used to facilitate overhaul and maintenance of the unit and to observe the operating status of the unit. Usually the range of it is selected from 0°C to 100°C.
Water Pump	The water capacity of water pump is selected according to the water flow parameters of the unit: Water capacity of pump = $L \times 1.1$ (L— water flow of the unit); the pump lift is calculated according to the following formula: Pump lift = [water resistance of the unit + most unfavorable pipe length $\times$ (2%- 5%) + water resistance at the end of the most unfavorable path] $\times$ 1.1.
Automatic Air Discharge Valve	It is used to discharge air from the water system and make the unit operate normally. It is installed at the highest point of the system.
Expansion Water Tank	It is mainly used to contain the excessive water, stabilize water pressure in the system, and supplements water to the system. Generally it is installed at the return water pipe, higher than the water pipe in the system, so that the unit can operate properly. Its capacity is calculated according to the following formula:  Expansion water tank volume V=(0.03 to 0.034) Vc Vc—System water capacity
Energy Storage Water Tank	It is used for energy regulation to reduce frequent start/stop times of the compressor when the air conditioning system load changes so as to increase the system operation efficiency and to prolong the service life of the unit. Its capacity is calculated according to the following formula: Energy storage tank volume V ( $m^3$ ) = (Q/27.9n) - Vs Q — Cooling capacity (kW) n — Number of heads   Vs — Water capacity in the pipeline of the chilled water system and in the heat exchanger $m^3$

#### ★ Notes

The tested pressure value of the pipeline pressure test is greater than 1.25 times the operating pressure, but not less than 0.6 MPa. When the pressure is maintained for 5 minutes, the pressure drop is not greater than 0.02 MPa. The system is qualified when leakage is not detected.

The water pressure test cannot be performed when the air temperature is lower than 5°C. The pressure meter for the pressure test is qualified, with the precision not lower than grade 1.5, and the full scale value is 1.5 to 2 times the maximum tested pressure.

Water is added from the lower part of the system and air is discharged from the upper part. During the pressure test, add water slowly and evenly to reach the pressure, stop the pump, and check the system. Repair cannot be performed when there is pressure in the system.

After the pressure test is qualified, rinse the water pipeline repeatedly (do not pass the equipment) till impurities such as silt and iron filings are not contained in the drained water and water is clear.

## **Routine Maintenance**

TICA recommends the user record the routine operating data of air-conditioning equipment and regularly carry out maintenance.

- 1. Before using the unit for the first time, check the functioning of the air side equipment and other parts of the water system.
- 2. (Recommended) Use the following service schedule to maintain the unit:

Daily inspection  Monthly inspection	Check whether the unit generates any alarm						
	2. Check whether the air discharge and air suction pressures and oil pressure are normal						
	3. Check whether the oil level is normal (check through the oil sight glass to ensure proper amount of oil)						
	4. Check for any abnormal compressor or fan noise						
	5. Check for odors inside the startup cabinet and control cabinet						
	6. Check whether the temperature sensor and temperature probe are securely fixed						
	7. Check for any appearance damage of the unit and whether heat exchanger or discharge fan is blocked						
	Check whether the water pump and valve function normally						
	Check the appearance of water pipes for damages and leakage						
	1. Check the coil of compressor oil (the oil should be clear and clean; if the color turns dark brown or muddy, replace the oil; if the oil turns black, disassemble and inspect the compressor)						
	2. Check the color of the test paper in the sight glass of liquid supply pipe (yellow indicates that the refrigerant has excessive water content)						
	3. Check for leakage in the refrigerant loop (whether there is any greasy dirt or sound of leak)						
	Clean the startup cabinet and control cabinet						
	5. Check cleanness of the water line filter, and clean the filter when necessary						
	6. Check the water quality, and send the water sample for laboratory analysis if possible (water quality should comply with the standard Code for Design of Industrial Recirculating Cooling Water Treatment or other relevant standards)						





Inspection Based on Service Life or		1 year	2 years	3 years	4 years	5 years	
inspection	1000 hours	3000 hours	5000 hours	7000 hours	9000 hours	Abnormalities	
	Motor				☆		Insulation resistance during the inspection is abnormal.
	Solenoid valve	☆	☆	☆	☆	☆	Insulation resistance during the
Compressor	Oil heater	$\stackrel{\wedge}{\Longrightarrow}$	☆	☆	☆	☆	inspection is abnormal.
	Compressor oil filter	*	*	*	*	*	Oil pressure alarm
	Lubricant	*	*	*	*	*	Metamorphic and muddy
	Fin heat exchanger		*	☆	*	☆	Corrosion, filth blockage, and slight leakage
Heat exchanger	Shell-and-Tube Heat Exchanger		*	☆	*	☆	Temperature difference for heat exchange exceeds 3°C
J	Check the water inlet/outlet pressure difference (refer to the table of unit specifications)	*	*	*	*	*	Water pressure difference is too large or too small. Adjust the water flow until it meets the requirements.
	Solenoid valve	☆	☆	☆	☆	☆	The valve cannot be opened or closed normally.
Valves	Electronic Expansion Valve						Check whether the resistance and opening are normal.
	Float valve	☆	☆	☆	☆	☆	The valve cannot ensure normal liquid supply.
	Fuse	☆	☆	☆	☆	☆	Disconnection
	Contactor	☆	☆	☆	☆	☆	Serious contact electro-corrosion or noise during running
	Sensor	☆	☆	☆	☆	☆	Measured value still varies from the actual value even after calibration.
Electric	High pressure switch	☆	☆	☆	☆	☆	Controller false alarm.
	Fastening wiring terminal	*	*	*	*	*	The contactor gets loose or can flexibly rotate when turning the connecting cable.
	Checking power supply	*	*	*	*	*	Rated voltage ±10%, phase-to-phase unbalance < 2%.
	Checking phase	*	*	*	*	*	No phase loss or reverse phase

Notes: ① ★-----Required maintenance or replacement items; ☆----- Determine the maintenance items according to actual conditions.

- ② Daily and monthly inspections should be performed and recorded by the user.
- ③ The replacement of consumable parts and materials is determined by the service life or operation duration of the unit. For units that operate all year around and those for the purpose of process, the operation duration should prevail; for units under normal operation and those for comfort, the service life should prevail.

After the initial 1000-hour operation of the unit, replace the lubricant, oil filter, and other filters in the refrigerant system.

After that, perform laboratory analysis on the refrigerant and oil every 2000 operating hours, to check whether the refrigerant or oil needs to be replaced.

Relevant sealing pad shall also be replaced when replacing the lubricant and filter.

4 Consumable parts and materials include refrigerant, refrigerant oil, oil filter, dry filter element, dry filter screen, filter screen of electric cabinet, battery, water side sealing pad, etc.

Date	Subject

TICA Z












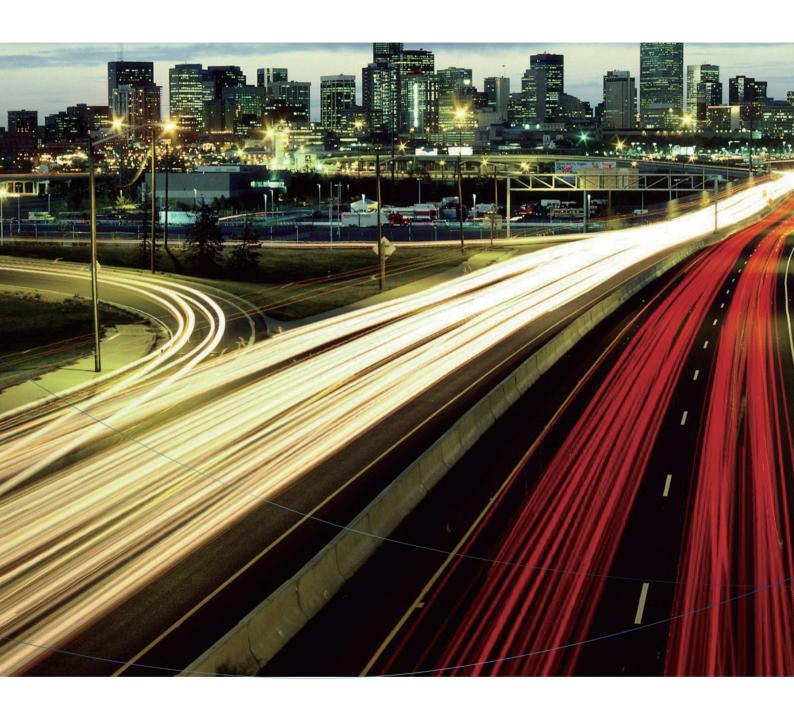

### TICA PRO LLC

Tel. +7(495)127-79-00 E-mail: info@tica.ru

Website: https://en.tica.pro/



Note: Due to constant improvement and innovation of TICA's products, the product models, specifications and parameters contained in this document are subject to change without prior notice.